


Neenah Catalog No. R-1713 manhole frame, Type "B" self-sealing solid lid w/ "WATER" and "CARPENTERSVILLE" imprint (or equivalent East Jordan Iron Works frame and lid.)

Adjustment: Three adjustment rings totaling 8" in height may be used. No more than two (2) of those rings may be precast concrete. The top ring in paved areas with crown adjustments shall be rubber.

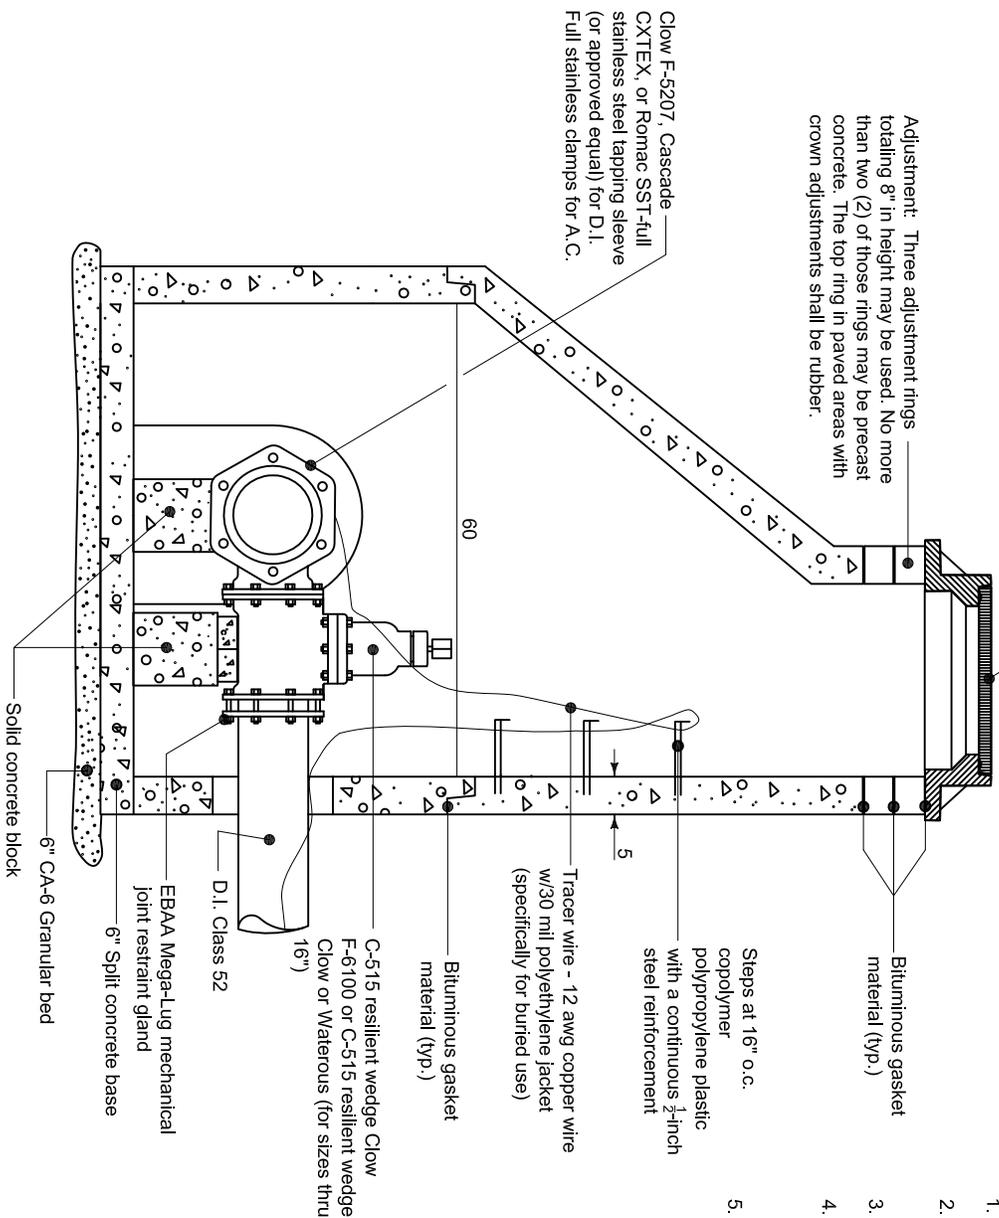

- General Notes**
1. All dimensions are in inches unless otherwise specified.
  2. Water main shall be Class 52 ductile iron pipe with cement coating C-104.
  3. Fittings shall be ANSI-AWWA C153/A21.53 SSB-COMPACT.
  4. Eccentric cones shall not be used unless underground conditions require them and they are accepted by the Village Engineer.
  5. 72" vault require when pressure connection is larger than 10"

**Pressure Connection**

W-3 012908